



## Techno-economic Feasibility Study of the Gunde Teklehaymanote Micro-hydropower Plant at Tindwat River, Central Gondar, Ethiopia

A. K. Belay<sup>1\*</sup>, D. Atenafu<sup>2</sup>, S. Birhan<sup>3</sup>, T. Tegengn<sup>1</sup>

<sup>1</sup> Mechanical Engineering Department, Institute of Technology, University of Gondar, Gondar, Ethiopia

<sup>2</sup> Hydraulics Engineering Department, Institute of Technology, University of Gondar, Gondar, Ethiopia

<sup>3</sup> Electrical and Computer Engineering Department, Institute of Technology, University of Gondar, Gondar, Ethiopia

### PAPER INFO

#### Paper history:

Received 14 May 2020

Accepted in revised form 08 June 2020

#### Keywords:

Prefeasibility Analysis

Small Hydro Power

Tindwat River

Turbines

### ABSTRACT

Ethiopia has a high potential for water for hydro-power development. Even though there is untapped potential, the country's electricity coverage is poor. This paper presents a technical-economic feasibility study of gunde micro hydropower at the Tindwat River, Central Gondar, Ethiopia. In the techno-economics study, the analysis was made for energy modeling, economic scenarios, and sensitivity, risk, and emission analyses. The study shows that this mini-hydropower project can be developed with an installed power of 18 kW, where the Kaplan turbine is recommended. The construction of small scale hydropower in the tindwat river is technically and economically feasible with total net present cost of US \$ 253537, cost of energy \$0.09/kWh, simple payback period of 5.9 years, and internal rate of return 23.9%. The result also shows that construction of hydropower curtails greenhouse gas emissions of carbon dioxide by 588.65m<sup>3</sup> of gasoil per year. It also showed that small hydroelectric power generation from Tindwat River would improve the electricity supply to Gunde Teklehaymanote monastery and off-grid rural communities.

doi: 10.5829/ijee.2020.11.02.06

## INTRODUCTION

In our world, the most important element is energy. It is also a crucial factor in education, health, and transportation for an equitable standard of living, economic development, and employment. Even though it is important, the status and comparison between the regions is as follows. According to literature [1] report, it is revealed that the electric access level of in Latin America 74%, North Africa 98.4%, South Asia 60%, Middle East 72%, and for Sub-Saharan Africa (SSA), it is only 14%.

Among all renewable energy resources, hydropower is the most reliable, new source in the future, and its share is more than 92%, according to literature [2] for generating energy. However, unreality and serious shortage are common features of electricity generation in sub-Saharan African countries [3].

Ethiopia is a country located in the Sub-Saharan region. The country is also lucky with ample water resources that can be used for power generation. Hydropower is the main energy resource for poverty reduction and sustainable development in Ethiopia [4]. The potential to produce electric from hydro power is over 45,000MW [5]. The current installed capacity

of 4,284 MW is 97 per cent renewable of which effective hydropower installed capacity is 3,810 MW. Also, 8,864 MW of hydropower development is under construction including Grand renaissance dam (GRED) [5].

Classification of hydropower is different from region to region, but according to literature [6], the definition of small hydropower (SHP) is a plant that will produce electricity power less than 25 MW. This plant also has a subclass into three (small, mini, and micro). The plant, which produces less than 100 kW is called micro hydro power. If the plant produces power between 100 kW to 2MW, which is called a mini-hydropower plant. The power production range from 2MW of 25 MW is called a small hydropower plant. The micro-hydroelectric energy system is planted, which will produce power from 5-100 kW when it is fitted on and across a river. This system stores power in the form of water and performs like a battery. When compared with a similar size, a power plant from another resource. It has high efficiency (70-90%), high capacity factor (>50%), slower rate of change, and maximum power output it is referred to literature finding [7].

In Ethiopia, different pilot MHP sites (cross-flow turbines) in the Sidama Zone/SNNPR with a capacity of 7 kW

\*Corresponding Author Email: anta.energy@gmail.com (A. K. Belay)

(Gobecho I), 30 kW (Gobecho II), 33 kW (Ererte) and 55 kW (Hagara Sodicha), respectively and upgraded a watermill in Jimma Zone/Oromia (Leku) into a 20 kW MHP, further a 10 kW MHP plant in Kersa were installed. In general several pico hydro schemes as well as 32 cross flow turbines exist, which power flour mills with out put from 5 to 32 kW. But 30-40 % of the plants are not operational due to lack of water (in dry season), management as well as technical problems [8].


Therefore, this paper examine techno-economic feasibility of gunde tekleyhaymanote micro-hydro-power plant in central gondar, Ethiopia, on a fall river of Tindwat. The paper also gives awareness to NGO who are working on energy, Governmental body, and private sector, to fund for construction of small hydro power in this area.

## METHODS AND MATERIALS

### Study site and materials

#### Location

The site is placed in the Misraq Belessa District, Centerla Gondar, Amhara Region of Ethiopia. The Misraq Belesa district is positioned on the south, with the aid of the south Gondar zone, on the west by Mirab Belessa, on the northwest through the Wegera, on the north by using Jan Amora, and on the east through the Wag-Hemra Zone. The towns in Misraq Belessa include Hamusit [9]. The tindawt River is placed eleven km from Hamusit city. It is also 70 km some distance from Gondar town. The region is placed on 12.3 °N and 37.65 °E. In the selected place, there is a large monastery, which is called Gunde Tekleyhaymanot. Near the monastery place formerly, there was once a water mill currently it is not in operation. Weir and the water root still exist solely require small maintenance to convert into micro hydropower. The area is proven as follows as shown in Figure 1.

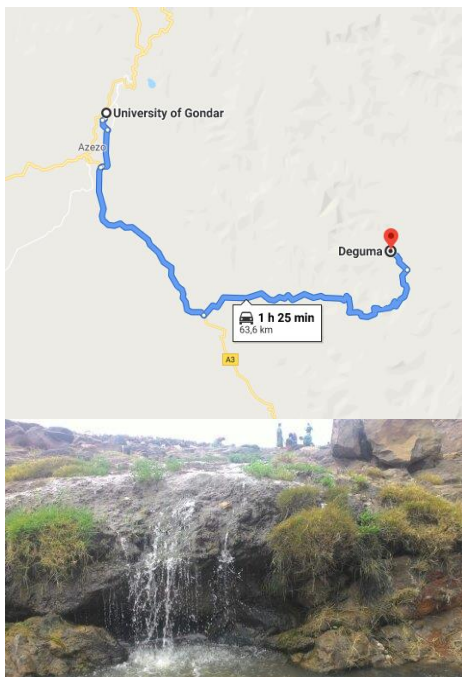

**Figure 1.** The path from University of Gondar to river at gond tekleyhaymanot

**Climate:** The temperature of the place is 25 to 29°C in the summer season and 20 to 23°C in winter. The relative humidity varies from 60 to 80%. The duration of rainfall in the area is from June to September, and the average annual rainfall is 1151 mm.

**Population:** Gunde Tekleyhaymanote area, the largest village with approximately one hundred households. In the monasteries, there are one hundred twenty monks and student populations in 30 rooms. Thus, the find out about location has 130 households, with a populations of about 620 people.

**Social structure of the people:** The total vicinity is inhabited by fragile socioeconomic prerequisites belonging to the lower-income group. There is only one foremost school in the village and for high faculties and colleges, college students have to go to neighboring towns. The medical unit is simply a major health center; for hospitals, the inhabitants have to tour to arbaya and Maxesgn. The houses in the cluster are made of mud houses. The literacy charge is very low, and most are school drop-outs. Almost all the humans of the vicinity rear cattle produce sufficient quantities of milk, which is provided close by the arbaya city.

### Materials

The materials used for the study were Global Positioning Systems (GPS), Meter, high measurement tools, electronic laser level, and Rescreen software. Different data were collected from the Ministry of Water and Energy as well as EEPCo for policy and supply issues. For consumer data, the project makes a survey of the project area. Moreover, the project collected tariff-related data from EEPCo's.

### Method

#### Technical method

The Gunde Micro Hydropower Study, two parameters were used to determine the hydropower potential sites, discharge, and head. The head is the altitude difference from the upstream to the downstream water level. The head was measured directly from the site. Discharge is the flow rate of the water, which will be collected for the consecutive ten years. The leaf floating method was used to determine the optimal discharge.

#### Power generation

The power equation for any small hydropower plant is as follows: This formula was used in the standard manual of the Japan International Cooperation Agency [10].

$$P = g * \rho * H * Q * \eta_{generator} * \eta_{turbine} \quad (1)$$

where  $g$  is the coefficient factor that is the acceleration of free fall  $9.81\text{m/s}^2$ ,  $\rho$  is the density of water,  $H$  is gross head in meters,  $Q$  is design flow in  $\text{m}^3/\text{s}$ ,  $\eta_{generator}$  is efficiency of the generator and  $\eta_{turbine}$  is the turbine efficiency.

#### Penstock size determination method

Penstock size was determined using a formula similar to data reported in literature [11]. The penstock diameter  $d$  can be calculated as follows:

$$d = 2.69 \left( \frac{n^2 Q^2 L}{H} \right)^{0.1875} \quad (2)$$

where  $D$  is diameter,  $Q$  is the flow rate,  $n$  is the manning

coefficient, H is the net head and L is the length of penstock in meters.

The length of a penstock for a given design consideration can be obtained as follows:

$$L = g * H * t_g / V \tag{3}$$

where  $t_g$  is water acceleration constant in pipe (s) and V is the flow velocity in  $ms^{-1}$ .

Manning’s roughness coefficient n is a coefficient that represents the roughness or friction applied to the flow of the channel. Typical values of n are given in Table 1.

**Turbines:** The turbine converts mechanical energy into electrical energy. There are different types of turbines. Three main types of turbines based on their heads are listed in Table 2. The selection of this turbine depends on the head and discharge. The output of the turbine can be calculated as follows:

$$P_{output} = g * H * Q * \eta_{turbine} \tag{4}$$

where  $\eta_{turbine}$  is maximum turbine efficiency, the efficiency of the turbine is different from that of turbine to turbine. Table 3 shows the efficiency of the various turbines used in hydropower.

**Financial analyses**

RETScreen V.4 software was used in analyze the economic feasibility of the project. This software can assess viability factors like the project site, equipment performance, initial costs, periodic project costs, financing, savings, and

environmental features. The Ethiopian National and NASA’s meteorological data were incorporated into the software. This paper uses methodology as reported in literatures [13, 14].

**RESULT AND DISCUSSIONS**

**Case studies**

The project site is situated on the central north and northwest highland plateaus of Ethiopia, under the sub-basin of Tekeze-Setit-Atbara. In this catchment area, the river network as follows: (1) the river called Tekeze in Ethiopia and Setit in Sudan, (2) the river Angereb, and (3) the river called Goang in Ethiopia and Atbara in Sudan. The geographic coordinates of the Platte River are shown in the following Figure 2. Latitude- 12.4’ North and longitude- 37.68° East.

Data required for analysis of the sites is summarized in Table 4.

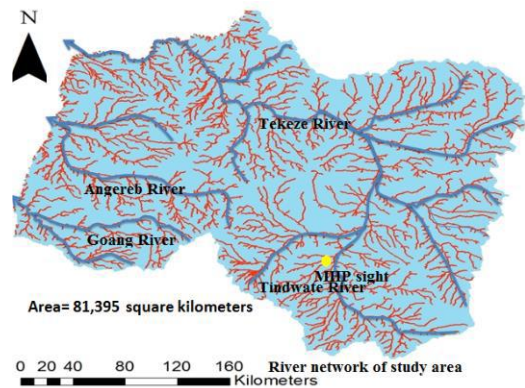


Figure 2. River network of the study area

TABLE 1. Commercial pipes manning coefficient n [12]

Pipe Made of	n
Steel Welded	0.012
Polyethylene (PE)	0.009
PVC	0.009
Asbestos Cement	0.011
Ductile Iron	0.015
Cast iron	0.014
Wood –stave	0.012
Concrete	0.014

TABLE 2. Classifications of turbines by head [11]

Turbine Type	Head		
	High < 40m	Medium 20-40m	Low 5-20m
Impulse	Pelton	Crossflow	Crossflow
	Turgo	Turgo Pelton	
Reaction		Francis	Propeller Kaplan
		Pump-as-turbine(PAT)	
		Kaplan Propellwe	

TABLE 3. Different types turbines Vs efficiency [12]

Turbine Type	Efficiency (%)
Pelton	80-90
Turgo	80-90
Cross-flow	65-95
Propeller	80-95

TABLE 4. Data required for analysis of the sites

Water course	Tindawat river
Water Regulatory Authority	Central Gondar Zone Energy Bearu
Site location	Gunde T/Haymanot monastery, Belesa, Central Gondar, Ethiopia.
Latitude	12.4 °N
Longitude	37.68 °E
Catchment Area (km <sup>2</sup> ) Tekeza basin	81,395
Turbine type	Kaplan
Dam crest length (m)	5
Road Length (km)	1.5
Canal length in rock (m)	17
Grid Center	Arbaya City
Transmission line (km)	25km
Transformer Losses (ζt)	1%
Conduit Head Percentage Losses (ζh)	5%
Parasitic Electricity Losses (ζp)	1%
Plant Availability (A)	98%

**Power equations for small hydropower**

The power generated can be computed using Equation (1), using the following assumptions stated in Table 5.

**Penstock size determination**

The water was transported from the intake to the powerhouse through penstocks. Depending on the nature of the ground, the penstock can be installed over and under the ground. In our design, the penstock can be installed above the ground. The internal penstock diameter (Dp) can be calculated from the flow rate pipe length and gross head [15]:

$$D_p = 2.69 * [n_p^2 * Q^2 * \frac{L_p}{H_g}]^{0.1875} \text{ m} \tag{5}$$


where n<sub>p</sub> is Manning’s coefficient, Q is the water flow rate (m<sup>3</sup>/s), L<sub>p</sub> is penstock length in (m) and H<sub>g</sub> is the gross head in (m).

**Hydrology and load**

Figure 3 shows discharge duration curve and the hydrology data analysis is shown in Figure 4.

**TABLE 5.** Assumption for calculating the power

Specification	Value
Gross Head (m)	17
Design flow(m <sup>3</sup> /s)	0.14
Generator Efficiency (η <sub>g</sub> )	98%
Turbine Efficiency (η <sub>t</sub> )	88.5%
Density of the water kg/m <sup>3</sup>	1000
P=1000*0.14*17*0.80*0.98	18304.75kgm <sup>2</sup> /s <sup>3</sup> =18.304 kw

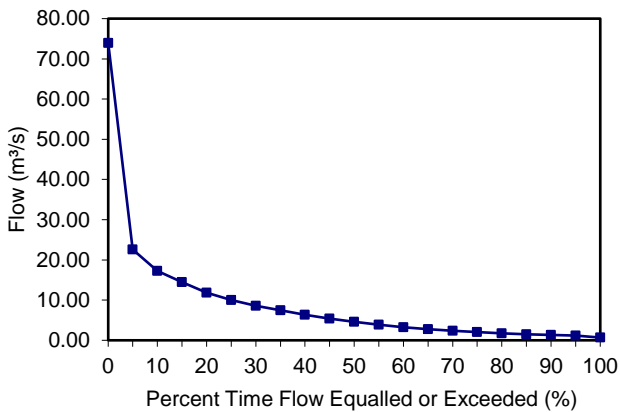

**Figure 3.** Discharge duration curve


**Turbine selection**

The turbine was selected considering the discharge and head. Based on the Figure 5, the fundamental component to select for a turbine is based on the head and flow rate. In our case, the head is 17 m and the flow rate of the river stream is 0.14 m<sup>3</sup>/s, the best turbine would be Kaplan. The main characteristics of Selected turbine are listed in Table 6.

**Final analyses**

**Financial parameters**

Undertaking was calculated for 50 years of lifetime. From the completion of a fifty-year lifetime in each 15-year small repair cost was calculated once. The annual escalation cost of Gasoil used to be calculated with the records from 2007-2014, as referred literature from previous work [16]. The inflation rate in Ethiopian was once calculated from the facts

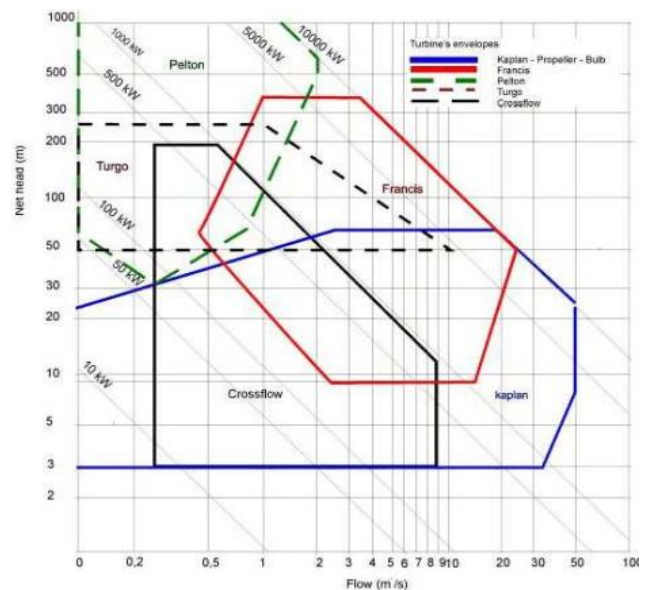

**Figure 5.** Turbine types and ranges of application [15]

**TABLE 6.** Selected turbine with key characteristics

Turbine Feature	
Maximum head	19 m
Design Head	17 m
Runner diameter	0.5 m
Design flow	0.14 m <sup>3</sup> /s
Unit output	18.34 kW
Turbine efficiency	88%

Hydrology Analysis		Estimate	Notes/Range
Project type		Run-of-river	
Hydrology method		Specific run-off	
<b>Hydrology Parameters</b>			
Residual flow	m <sup>3</sup> /s	0.05	
Percent time firm flow available	%	95%	90% to 100%
Firm flow	m <sup>3</sup> /s	1.09	

**Figure 4.** Analysis of hydrology data

from 1988-2010. The obtained value of the former is 1.1% that of the latter 2.6%. A discount rate of 10% was chosen once.

**Costs**

The complete preliminary value of the turbine and related equipment of the project are provided in Table 7. The complete initial price of the challenge is US\$ 253537.

The feasibility study, development, and engineering value were estimated at 12% of the initial cost, and the balance of plant and energy equipment was 42.7% and 35%, respectively. This discovery used to be similar to the finding said with the aid of the Instituto para la Diversificación y Ahorro de Energía [17].

**Results of the pre-feasibility study**

The economic indicators resulting from the profitability analysis carried out are summarized in Table 8.

As the ensuing economic indicators show, the herein described challenge would be fantastically profitable, the funding of which would be recovered then again shortly as the year positive cash flow is 5.9 years. That would produce advantages in the course of its complete lifetime. The research shows a very excessive internal rate of return (23.7%), which is pretty most dependent on the discount rate (10%). Figure 6 shows the growth of the net present value in the cumulative money float all via the project’s lifetime. The benefit-cost ratio indicates that for every dollar invested, \$2.03 will be received inclusive of all expenditures, which equates to \$7824 as annual savings.

**Risk analysis**

In the sensitivity analysis, the outcomes of viable variants of preliminary costs, preservation cost, and the price of fuel on the internal rate of return, the net current value, and the


payback duration were considered. The results are summarized and showcase that the most influential factor is the charge of facial gasoil followed by means of the preliminary costs. The price of fossil gasoil has an impact on all three financial indicators, while the initial value impacts the internal rate of return and the payback period mostly. The operation and preservation costs do not reflect on the showcase a necessary relative impact.

**TABLE 7.** Costs of turbine and related equipment

Initial Costs	Percentage	US \$
Feasibility study	7.6	19,260
Deveopement	8.0	20,330
Engineering	6.4	16,264
Energy equipment	29.4	74,633
Balance of plant	41.4	105,074
Miscellaneous	7.1	17,976
Total Intitial Costs	100	253,537

**TABLE 8.** Economic indicators of project’s profitability

Pre-tax Internal Rate of Return (IRR) and Rate of Return (ROI)	26%
After-tax IRR and ROI	23.7%
Simple Payback	10.7 years
Year to Positive Cash Flow	5.9 years
Net Present Value (NPV)	US\$ 52,112
Annual Life Cycle Savings	US\$ 7,824
Benefit/Cost (B/C) Ratio	2.03

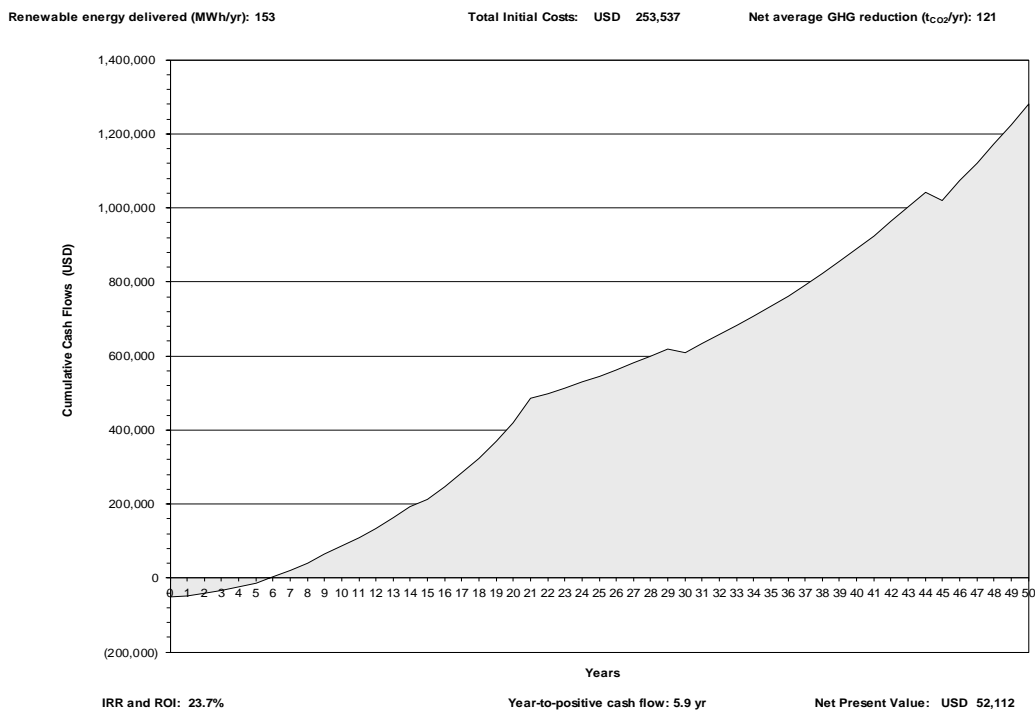

**Figure 6.** Cumulative cash flow

Resulting of the consequences of the sensitivity analysis, have an effect on the price of gasoil, and the initial cost on the profitability of the mission has been quantified with risk analysis. A large sensitivity vary of 20% was used to view both factors, that is, eventualities that mixed variations of each element ranging from -20% to 20% of the unique values have been considered. The results of the chance evaluation are tested in for the internal rate of return and a pay-back period, an multiplied of 20% in the preliminary costs, and a decrease of 20% in the rate of the gasoil end result in the worst-case scenario: an inside fee of return of 92% and a payback duration of 5.9 years. These are much less attractive, however nonetheless, very rewarding indicators, which shows that, even even though the mission is very touchy to variants in preliminary costs and the price of gas oil.

### Emission analysis

The result indicates that the greenhouse gas emission discount from the find out is 137 tonnes of equal CO<sub>2</sub> per year. This quantity is equivalent to keeping the consumption of 318.58 amount barely gasoil or 588.65 m<sup>3</sup> of gasoil per year.

### CONCLUSIONS AND RECOMMENDATIONS

The aim of this project is the techno-economic feasibility study of gunde tekleyaymanot mini hydropower in the Tindwat River. The installation feature is a run-of-river hydraulic power plant. Based on the head and discharge data of the river, the total installed is 18 kW of a standalone system. The recommended turbine for the gadget is the Kaplan turbine. The end result indicated that a total asset of US\$ 253537 are required to install the plant. The payback period of the undertaking is 6.9 years. The internal rate of return, payback period, and benefit-cost ratio were 23.7%, 5.9, and 2.03, respectively.

The threat and sensibility analyses of the assignment been proved that the task can stop profitable even on the critical cost variant of facial and fuel oil and initial costs. Based on environmental analyses, the task ought to minimize 137tonnes CO<sub>2</sub> per annum.

The assessment results showed that small hydroelectric energy technology from Tindwat, River can make contributions to small measures to improve the electricity supply to close by rural communities because the electrical energy needs of these communities are modest. Widespread improvement of small hydropower can make a contribution immensely to improving rural electricity get entry to degrees all through Ethiopia.

### ACKNOWLEDGMENT

The authors would like to acknowledge the financial support of the University of Gondar, Research and the vice president's office, and En-Dev Ethiopian office.

### REFERENCES

1. Mohibullah, M., Radzi, A.M. and Hakim, M.I.A., 2004. Basic design aspects of micro hydro power plant and its potential development in Malaysia. In PECon 2004. Proceedings. National Power and Energy Conference, IEEE, pp. 220-223.
2. Yemtsa, G. and Steven, M., 2009. Hydropower: The Small Versus Large Debate and the Policy Decisions Implications in Developing Countries. In: The Future of Energy: Global Challenges, Diverse Solutions. International Association for Energy Economics. Leeds, United Kingdom.
3. Kaunda, C.S., Kimambo, C.Z. and Nielsen, T.K., 2012. Potential of small-scale hydropower for electricity generation in Sub-Saharan Africa. ISRN Renewable Energy, 2012: 1-15. <https://doi.org/10.5402/2012/132606>
4. Abebe, N., 2014. Feasibility Study of Small Hydropower Schemes in Giba and Worie Subbasins of Tekeze River, Ethiopia. Journal of Energy Technologies and Policy, 4(8): 8-17.
5. International Hydropower Association, 2018. Hydropower status report. International Hydropower Association: London, United Kingdom.
6. Nath, D.R., 2015. Small Hydro Power and its Potentiality in Assam. International Journal of Engineering Trends and Technology, 23: 391-395.
7. Nasir, B.A., 2014. Design considerations of micro-hydro-electric power plant. Energy Procedia, 50(50): 19-29.
8. Belay Kassa, A., 2019. Current Status, Future Potential and Barriers for Renewable Energy Development in Ethiopia. Iranian (Iranica) Journal of Energy & Environment, 10(4): 269-274.
9. Rural Electrification Executive Secretariat, 2006. Off-grid Rural Electrification Master Plan Study, Addis Ababa.
10. Japan International Cooperation Agency, 2009. Manuals and Guidelines for Micro-hydropower Development in Rural Electrification, Volume I, Department of Energy, Energy Utilization Management Bureau.
11. Adejumobi, I.A. and Adebisi, O.I., 2011. Equipment Selection for a Sustainable Small Hydropower Scheme. In Top Research Group Conference, Lome, Togo.
12. Adejumobi, I.A. and Adebisi, O.I., 2011. Exploring small hydropower potentials for domestic and information communication technology infrastructural application in rural communities in Nigeria. In Proceeding of the 12th Biennial International Conference of Botswana Institution of Engineers, Gaborone, Botswana, pp. 19-26.
13. Kosnik, L., 2010. The potential for small scale hydropower development in the US. Energy Policy, 38(10): 5512-5519.
14. Alonso-Tristán, C., González-Peña, D., Díez-Mediavilla, M., Rodríguez-Amigo, M. and García-Calderón, T., 2011. Small hydropower plants in Spain: A case study. Renewable and Sustainable Energy Reviews, 15(6): 2729-2735.
15. Penche, C., 1998. Layman's guidebook on how to develop a small hydro site. DG XVII, European Commission, Belgica.
16. Uamusse, M.M., Tsamba, A.J., Matsinhe, J. and Persson, K.M., 2015. Capacity Optimization Study of Chua Mini-Hydropower Plant at Chua River, Manica, Mozambique. Energy and Power Engineering, 7(13): 604-612.
17. Bertrand, K.S.E., Hamandjoda, O., Nganhou, J. and Wegang, L., 2017. Technical and economic feasibility studies of a micro hydropower plant in Cameroon for a sustainable development. Journal of Power and Energy Engineering, 5(9): 64-73.

## چکیده

اتیوپی پتانسیل بالایی برای منابع آب و توسعه انرژی حاصل از آب را دارد. حتی اگر پتانسیل بلااستفاده ای وجود داشته باشد، پوشش برق کشور ضعیف است. در این مقاله یک مطالعه امکان‌سنجی فنی و اقتصادی از نیروگاه آبی روستایی در رودخانه تیندوات، گوندار مرکزی، اتیوپی ارائه شده است. در مطالعه فنی و اقتصادی، تجزیه و تحلیل برای مدل‌سازی انرژی، سناریوهای اقتصادی، و تجزیه و تحلیل حساسیت، ریسک و انتشار گاز انجام شده است. این مطالعه نشان می‌دهد که این پروژه می‌تواند با توان نصب شده ۱۸ کیلووات توسعه یابد، جایی که توربین کیلان توصیه می‌شود. ساخت نیروگاه آبی مقیاس کوچک در رودخانه تیندوات از لحاظ فنی و اقتصادی با هزینه خالص فعلی ۲۵۳۵۳۷ دلار، هزینه انرژی ۰/۰۹ دلار به ازای هر کیلووات ساعت، دوره بازپرداخت ساده ۵/۹ سال و نرخ بازده داخلی ۲۳/۹ درصد امکان پذیر است. نتایج همچنین نشان می‌دهد که ساخت نیروگاه آبی باعث کاهش انتشار گازهای گلخانه‌ای دی اکسید کربن توسط ۵۸۸/۶۵ متر مکعب بنزین در سال می‌شود. همچنین نتایج نشان داد که نیروگاه برق آبی کوچک از رودخانه تندوات نیاز برق مساجد گوند تکلهایمانوت و جوامع روستایی خارج از شبکه را بهبود می‌بخشد.